


Note:

- ① Match existing driveway apron type, width and elevation at matchline unless otherwise directed by engineer (See Plans).
- ② If existing driveway is concrete (beyond apron), apron and driveway shall be constructed of 6" concrete with 6" x 6" - 6/6 welded wire fabric per MnDOT Spec. 3303 in flat sheets, not rolls. Epoxy coated dowel bars per MnDOT Spec. 3302 shall along the sawcut. Dowel bars shall be properly coated with a MnDOT approved lubricant. Dowel bars shall be size #4 and placed at 24" OC spacing. All work shall conform to MnDOT Spec. 2301 and 2531. Concrete shall be ready-mix 4,000 PSI at 28 days, with air content of 5% to 7%, coarse aggregate shall be 1" max, class A and per MnDOT Spec. 3137. Joint sealer shall be hot-poured, low modulus, mastic type per MnDOT Spec. 3725. Membrane curing compound shall be per MnDOT Specs. 3754 and 2301.3J.
- ③ If existing driveway is gravel (beyond apron), apron and driveway within R/W shall be constructed per existing bituminous driveways. Gravel driveways matching beyond R/W shall be 6" Class 5.

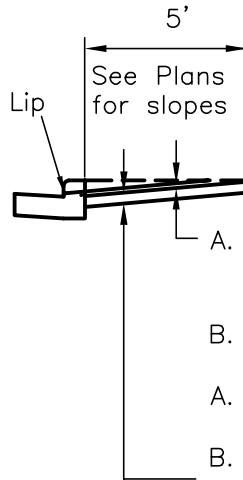

- A. Type SP 9.5 Bituminous, (SPWEA240C), 2" Thick MnDOT Spec. 2360
- B. 6" Reinforced concrete slab, MnDOT Spec. 2301 and 2531
- A. 4" Class 5 aggregate base, MnDOT Spec. 2211
- B. 4" Select granular base, MnDOT Spec. 3149

- ④ If existing driveway is bituminous (beyond apron), apron and driveway behind apron shall be bituminous per A. above. All bituminous work shall conform to MnDOT Specifications 2112, 2211, 2357 and 2360. Tack coat is to be applied between concrete and bituminous surfaces.
- ⑤ Driveways in fill sections to slope up from 1" curb lip to end of apron (5' from back of curb) at min of 2% then slope to matchline. See Plan for slope.

PRIVATE DRIVEWAY/FIELD ENTRANCE HL-363A1

NOT TO SCALE